




Built-In, Efficient GULFSTREAM Air Vent System

for Spa Chairs

GULFSTREAM Air Vent System provides room purification, can minimize inhalation exposure and reduce the health risk of your customers and salon technicians.

GULFSTREAM Air Vent System improves indoor air quality with two built-in, adjustable ventilation valves.


This system is available in some products.

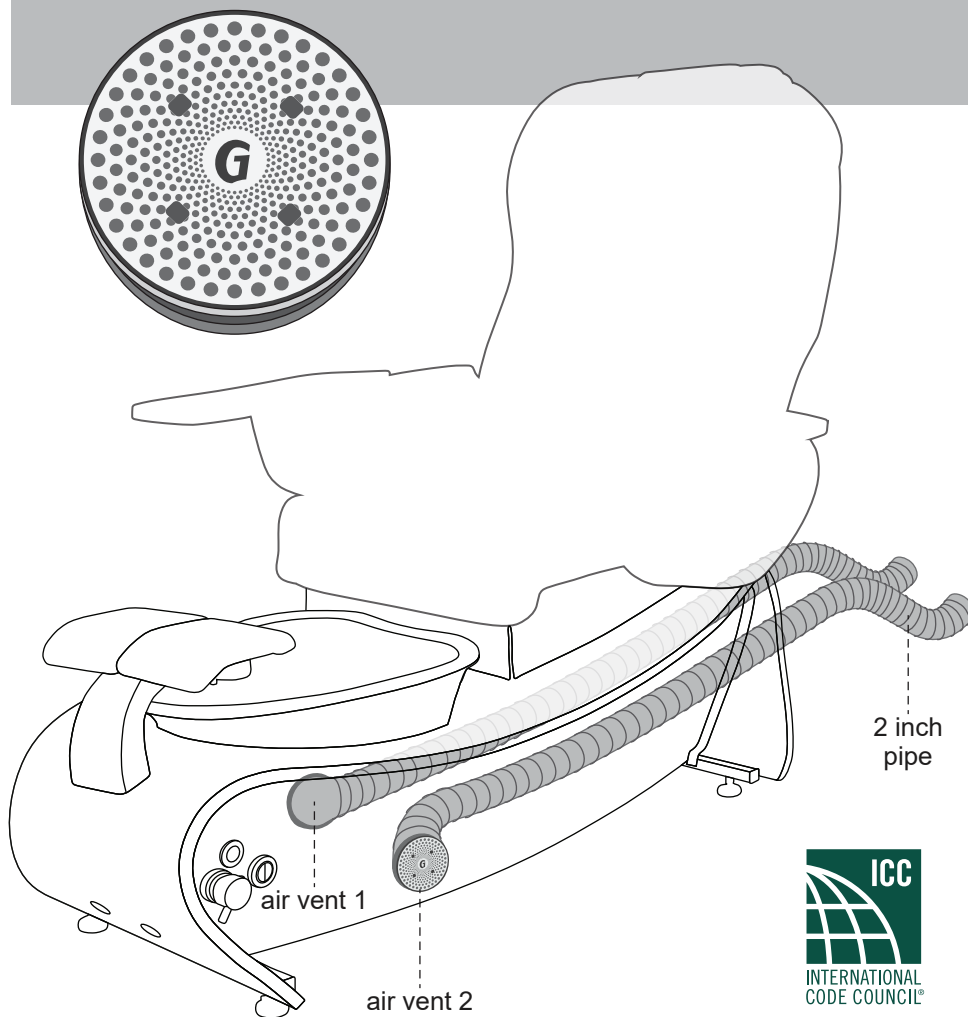

Example Wall Hook-Up

Always check municipal specific ordinances and local codes.

Find the Part: <https://a.co/d/27t3f38>

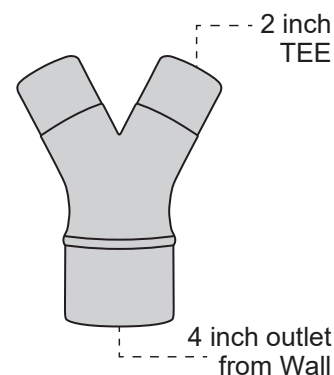

ICC Minimum Ventilation Rates

Occupancy Classification: **Beauty and Nail Salons**

People Outdoor Airflow Rate in Breathing Zone, **cfm/person:** **20**

Default Occupant Density, **#/1000 ft^{2a}:** **25**

Area Outdoor Airflow Rate in Breathing Zone, **R_A cfm/ft^{2a}:** **0.12**

Exhaust Airflow Rate, **cfm/ft^{2a}:** **0.6**

- Mechanical exhaust is required and recirculation is prohibited except that recirculation shall be permitted where the resulting supply airstream consists of not more than 10 percent air recirculated from these spaces.

- For nail salons, the required exhaust shall include ventilation tables or other systems that capture the contaminants and odors at their source and are capable of exhausting a minimum of 50 cfm per station.

Source: IMC Sec 502.20 Manicure and Pedicure Stations. Manicure and Pedicure Stations shall be provided with an exhaust system in accordance with T 403.3.1.1, Note h... *

* Note h is as follows: "For nail salons, each manicure and pedicure station shall be provided with a source capture system capable of exhausting not less than 50 cfm per station..."

Disclaimer: Always check municipal specific ordinances and local codes.




www.gulfstreaminc.com



GULFSTREAM Air Vent System Hose Specification

for Spa Chairs

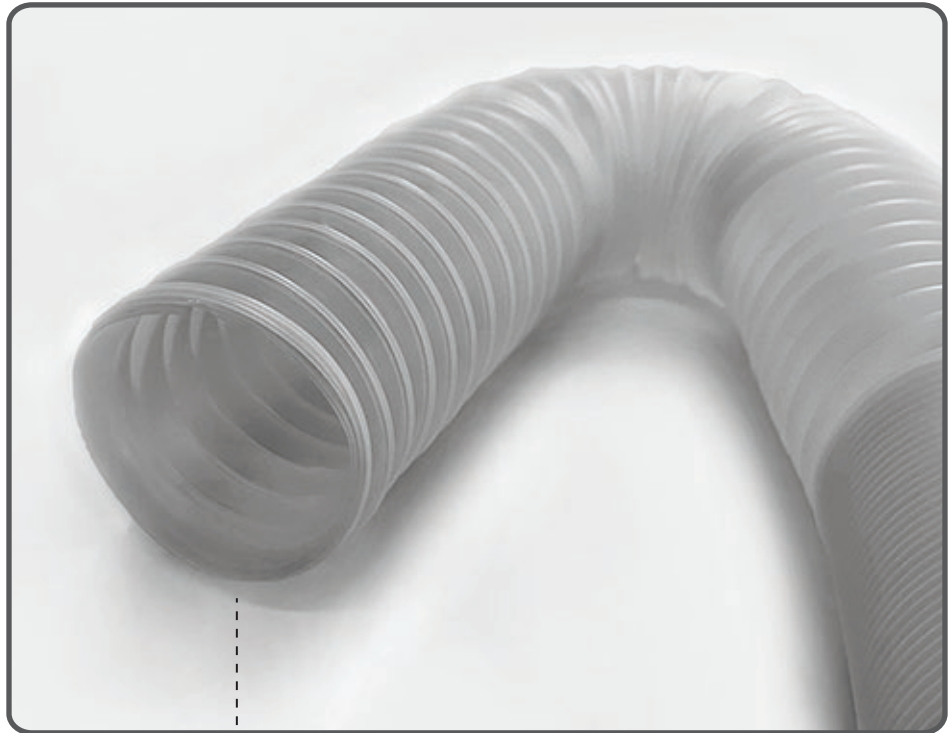

air vent 1

air vent 2

2 inch
pipe



www.gulfstreaminc.com